



ISSN (Print) : 2320 – 3765
ISSN (Online) : 2278 – 8875

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

Establishment of Distributed Generation System for Power Quality Improvement

P.Hemanth Kumar¹, Mopidevi Ravikanth², Elijah Keerthi chandra³, Ede Nageswararao⁴

Assistant professor, Dept. of EEE, Sri Vasavi Institute of Engineering and Technology, Nandamuru, AP, India¹

Assistant professor, Dept. of EEE, D.M.S.S.V.H College of Engineering Machilipatnam, AP, India²

Assistant professor, Dept. of EEE, S.R.K Institute of Technology, Vijayawada, AP, India³

Assistant professor, Dept. of EEE, D.M.S.S.V.H College of Engineering College, Machilipatnam, AP, India⁴

ABSTRACT: The establishment of Distributed Generation (DG) systems prompts consonant mutilations, unequal power sharing among the host feeders and framework voltage and recurrence lopsided characteristics. These power quality issues emerge generally when fundamental matrix cooperates with DG systems or when they work in islanded mode. From now on, with a two-stage approach as this paper presents, legitimate recurrence and voltage control of DG systems is gained to take care of these issues. In the initial step, a correlation as far as consonant substance is performed between PI controller and Fuzzy Logic Controller procedures for interface inverters in appropriated design. Also, a Multi-level inverter is executed keeping in mind the end goal to control voltage and recurrence as a capacity. Approval of outline strategy and parametric examination of results is given the assistance of recreations.

KEYWORDS: Power Quality, Distributed Generation Systems, Total Harmonic Distortion, Multi-Level Inverter, Hybrid Control Strategy.

I. INTRODUCTION

The fuse and incorporation of non-customary or renewable energy sources in the framework brings about another term called "Dispersed Generation (DG)" which remains for on location era in power markets [1]. "The appropriated era framework is a web of power sources joined together to perform in a proficient, solid and adaptable way" [1]. DG framework parts contain smaller scale sources (fuel cells, sun oriented, wind, and so on.), burdens, stockpiling systems, control and correspondence hardware and matrix intuitive inverters. Adjusting interest and supply is halfway done by utilizing nearby capacity i.e. batteries, straightforwardly fixing to the DC network" [2]. The advancement of dispersed era is a consequence of number of elements identified with normal remote utility era and transmission framework, for example, maturing, crumbling costs, and energy loses over long power transmission network. It is trusted that disseminated era is fit for dodging the requirement for the advancement of new transmission and appropriation lines. At the base, the network must be accessible as a reinforcement supply in order to build the framework unwavering quality in the meantime [3]. The connection between circulated era and power quality is uncertain however vital. On one hand, a few specialists stretch the negative impact on power quality by the establishment of DG systems, while others underscore its helpful impacts for power quality intricacies in power networks [4]. For instance, in ranges where the utility lattice is feeble and voltage support is troublesome, DG can add to an ascent of voltage in the network. By the by, dispersed generators bring sounds into the power framework. The sorts and seriousness of sounds rely on upon the power converter innovation and interconnection arrangement. This original copy shows a basic yet consistent and adaptable way to deal with tackle the issue of music in DGs, keeping into record legitimate power partaking if there should be an occurrence of different sources and loads. A parametric examination of sinusoidal heartbeat width adjustment (SPWM) PI Controller and Fuzzy Logic Controller for interface inverter in conveyed setup with the framework has been exhibited. This investigation gives the premise of ideal remuneration of music to improve power quality at framework level. The consolidated framework impact characterizes new ideal models of enhanced DG systems as far as execution, productivity and financial aspects. "From the consonant demonstrating and recreation point of view, a dispersed generator is normally a converter-inverter sort unit and can consequently be dealt with as a non-direct load infusing sounds into the dissemination feeder" [11].



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

Sounds in yield line-line voltage of three stage voltage source inverters can be ascertained by the accompanying condition

$$V_{ab} = \sum_{n=1,3,5,7,9}^{\infty} (4V_s/n\Lambda) \cos(n\Lambda/6) \sin(n(\Lambda t + \Lambda/6)) \quad (1)$$

Where,

n is an odd number. It can be noticed that triplen harmonics ($n=3,6,9, \dots$) would consequently be zero in line-line voltages. The other line-line voltages can be given as

$$V_{bc} = \sum_{n=1,3,5,7,9}^{\infty} (4V_s/n\Lambda) \sin(n\Lambda/3) \sin(n(\Lambda t - \Lambda/2)) \quad (2)$$

$$V_{ca} = \sum_{n=1,3,5,7,9}^{\infty} (4V_s/n\Lambda) \sin(n\Lambda/3) \sin(n(\Lambda t - 7\Lambda/6)) \quad (3)$$

Sounds emerge from the inverter exchanging and additionally because of the moves of smaller scale network between framework associated and islanded modes. They should be remunerated with a specific end goal to get the enhanced voltage profile at the heaps for power quality upgrade. In addition, amid the brace associated operation, contingent upon the plan of the generator windings (pitch of the loops), center non-linearity, grounding and different elements, there can be huge music display in the framework [14]. Triple music are added substance in the unbiased; and the third consonant is frequently the most predominant. Synchronous generators are frequently indicated with a 2/3 pitch for the windings as substantially less third symphonious is delivered than those with different pitches. Sadly a 2/3 pitch machine has a lower impedance to third consonant and may bring about more symphonious current to spill out of different sources associated in parallel with it [14]. The feeder entrance of sounds is restricted by the grounding course of action of the generator and venture up transformer.

II. DESIGN METHODOLOGY

The DG framework under thought comprises of an utility matrix with mass era from an expansive generator appraised at 132KV and two miniaturized scale networks associated through a Point of Common Coupling (PCC) to the utility lattice and disseminated loads. Miniaturized scale matrices have DC source evaluated at 400-800V DC. Circuit breakers (reclosers) are introduced for interfacing small scale matrices with the utility matrix shaping diverse zones. In lattice associated mode, power is encouraged to loads through the fundamental network. If there should be an occurrence of island (blame or inaccessibility of the matrix), power requests are satisfied through smaller scale lattices. This includes adaptability, productivity, and unwavering quality to the framework. Fig. 1 demonstrates the created framework display.

The abnormal state schematics of framework under thought are appeared previously. This framework has been further sorted into subsystems for displaying the dispersed generators small scale sources and voltage source inverters. The subsystem gives a voltage and power yield at the purpose of normal coupling with the primary network. There are two sorts of controls for this framework. One is supervisory control for the network and other is appropriated control for inverters [15]. Exact Harmonic Distortion by Multi-level Inverting control. Subsystems for PI and Fuzzy are appeared in fig. 2 and 3 separately. For power sharing utilizing hang control, it is prove that dynamic power-voltage (P-V) hang and receptive power-edge (Q-) support capacities are the genuine measure of dynamic and responsive power sharing when the network is thought to be low voltage. These capacities can be demonstrated by the accompanying arrangement of conditions.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

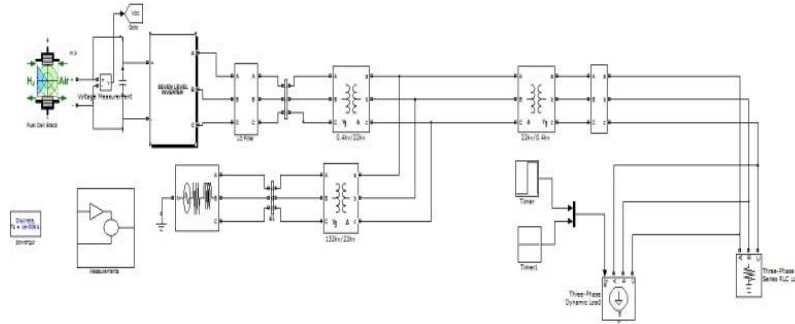


Fig.1.MATLABmodel of DGsystemunderconsideration

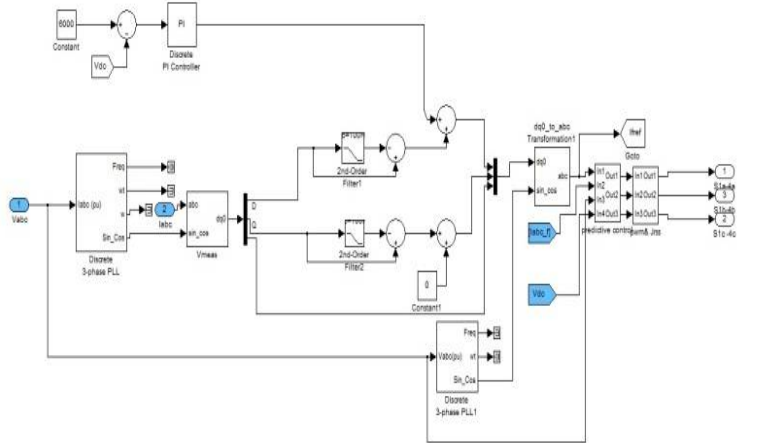


Fig.2.Subsystemmodel for PI-SPWMbasedmicro-grid inverter

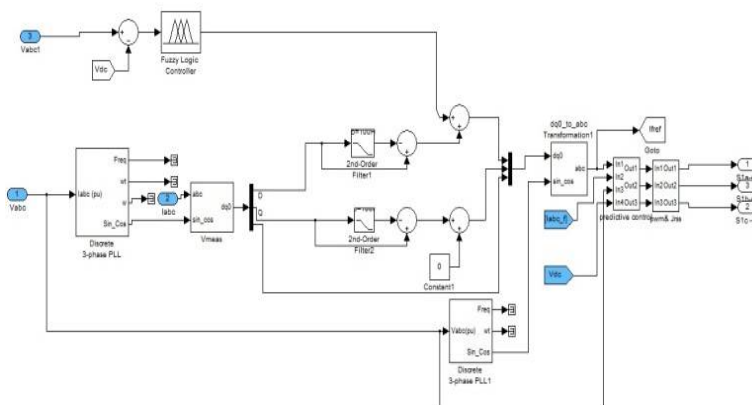


Fig.3.Subsystemmodel for FLC-SPWMbasedmicro-grid inverter

$$\omega = \omega_0 + k_q(Q_0 - Q)$$

$$E = E_0 - k_p(P_0 - P)$$

Where,

k_p :voltage droop coefficient k_q :frequency boost coefficient ω_0 :nominal frequency

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

V_o :ratedphasevoltageamplitude
 P :realpoweroutputofmicro-gridinverter
 P_o :nominalrealpoweroutput
 Q :reactivepoweroutputofmicro-gridinverter
 Q_o :nominalreactivepoweroutput

III. EXPERIMENTAL AND SIMULATION RESULTS

The three-phase seven level inverter utilized is appeared as a part of fig. 4. The three-stage voltage source inverter shaping a DG or a smaller scale matrix subsystem. The consonant pay is finished by the consolidated framework operation [16] of inverter, adjustment plans and control calculation. The proposed framework utilizes both PI and FCL sinusoidal PWM strategies for small scale matrix inverters. Results are appeared in taking after subsections.

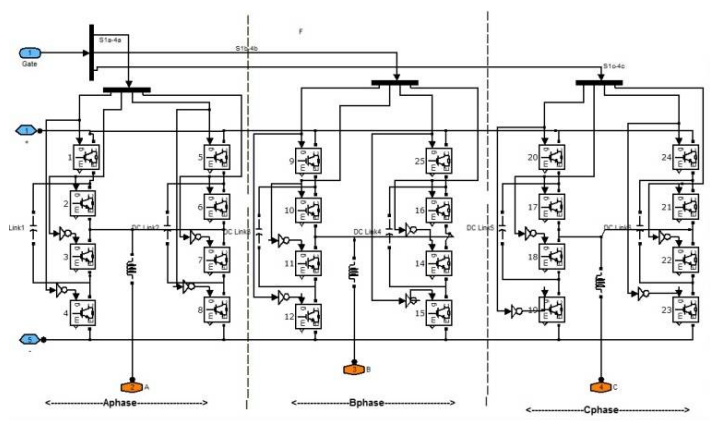


Fig4. Three-phase seven level inverter used in inverter-grid-load interface

A. PI controller - Sinusoidal Pulse Width Modulation based Micro-grid Inverter:

SPWM uses many more square waves (at a much higher frequency) to mimic the shape of a sine wave. Sinusoidal PWM technique, gives an output wave that is very easy to filter into a pure sine wave because very little energy has to be absorbed and later released during the cycles of the higher frequency signal. This means a much cleaner output with smaller inductors and capacitors can be obtained. Simulation parameters used for micro-grid inverter are shown in table 1. Voltage and current waveforms including line-line voltage, line-neutral voltages and phase currents of SPWM based micro-grid inverter are shown in fig. 6

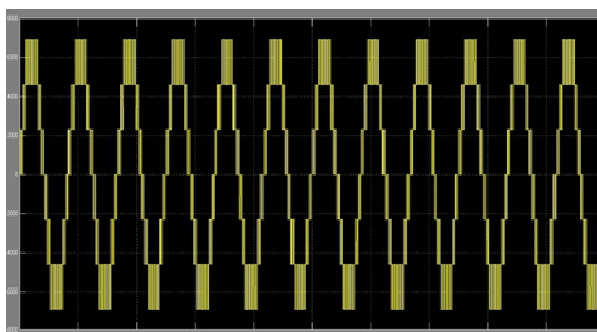


Fig.5. Single-phase seven level inverter output voltage

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

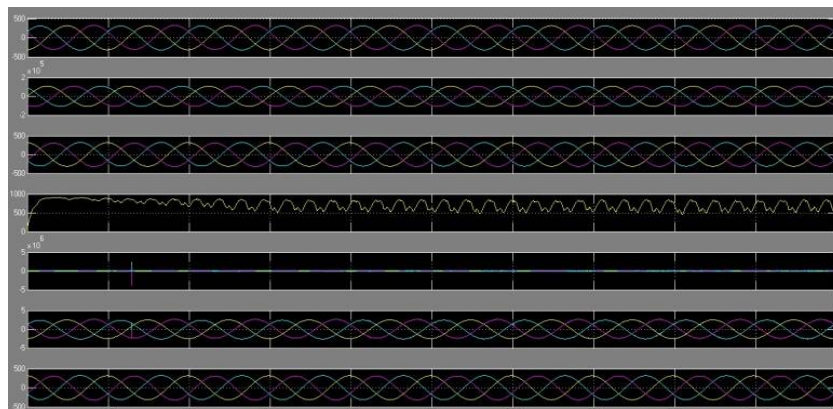


Fig.6.Line-line voltage,currentsof PI-SPWMbased micro-gridinverter

FFT examination of these waveform demonstrates that less measure of consonant substance is available. Add up to Harmonic Distortion (THD) examination demonstrates that smaller scale sources with control can lessen the consonant substance underneath 5% which is as per the IEEE permitted restrain.

A. FLC Sinusoidal PulseWidthModulationbasedMicro-gridInverter:

The word Fuzzy means dubiousness. Fluffiness happens when the limit of bit of data is not obvious. In 1965 Lofty A.Zahed propounded the fluffy set hypothesis. Fluffy set hypothesis displays massive potential for powerful tackling of the instability in the issue. Fluffy set hypothesis is an amazing numerical apparatus to handle the vulnerability emerging because of unclearness. Understanding human discourse and perceiving manually written characters are some basic occurrences where fluffiness shows. Fluffy set hypothesis is an augmentation of established set hypothesis where components have differing degrees of enrollment. Fluffy rationale utilizes the entire interim somewhere around 0 and 1 to portray human thinking. In FLC the information factors are mapped by sets of enrollment capacities and these are called as "Fluffy SETS".

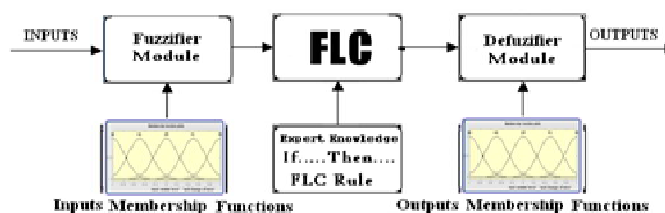


Fig.7:FuzzyBasic Module

Fluffy set contains from an enrollment capacity which could be characterizes by parameters. The esteem between 0 and 1 uncovers a level of enrollment to the fluffy set. The way toward changing over the fresh contribution to a fluffy esteem is called as "Fuzzification". The yield of the fuzzier module is interfaced with the principles. The essential operation of FLC is built from fluffy control rules using the qualities fluffy sets when all is said in done for the mistake, change of blunder and control activity. The outcomes are consolidated to give a fresh yield, controlling the yield variable and this procedure is called "Defuzzification".

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

FuzzyLogicControlRules:

$e/\Delta e$	NB	NM	NS	Z	PS	PM	PB
NB	NB	NB	NB	NB	NM	NS	Z
NM	NB	NB	NB	NM	NS	Z	PS
NS	NB	NB	NM	NS	Z	PS	PM

Fig.8:ControlStrategybasedon49Fuzzycontrol rules with combination of seven error states multiplying with seven changes of error states.

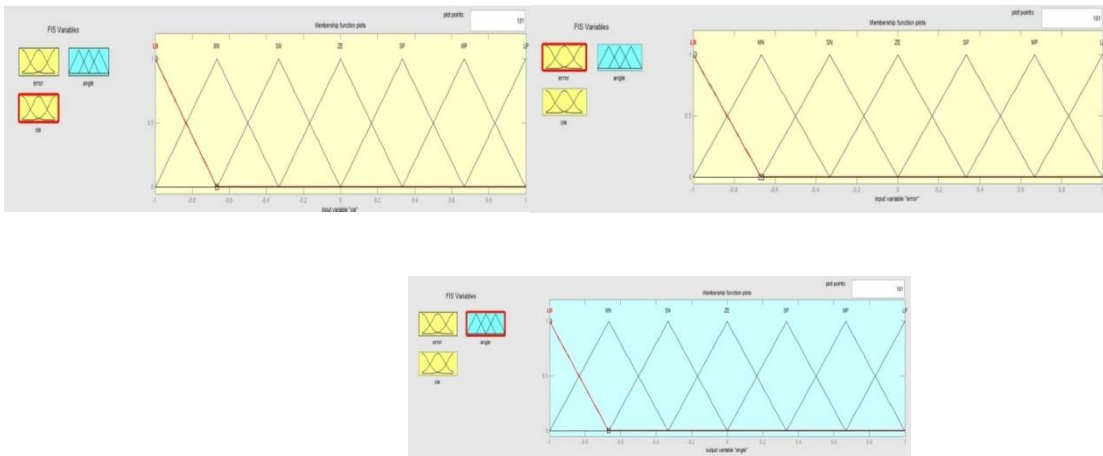


Fig.8:Membership Functions of FLC

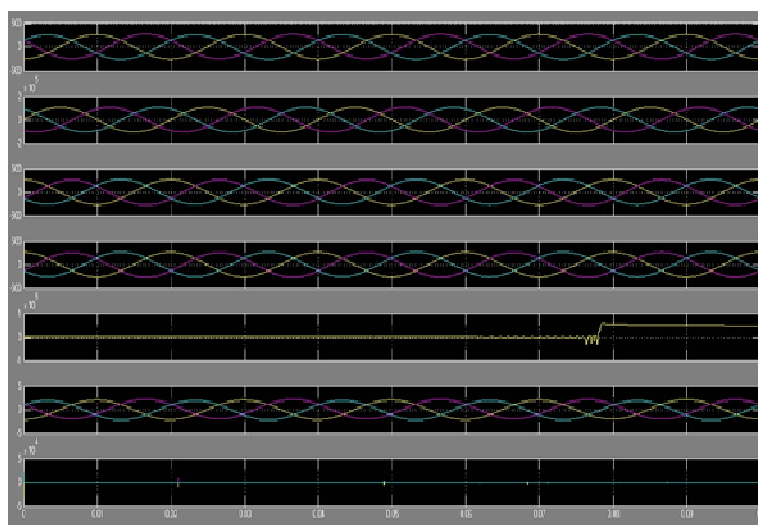


Fig.9.Subsystemvoltagesandcurrentswith FLC-SPWMbasedmicro-gridinverter.

Fluffy Logic Controlled Sinusoidal heartbeat width-regulation (SPWM) is utilized for small scale lattice inverters as a result of its quick ongoing reaction, low symphonious substance and high proficiency. It is a computerized tweaking system where the goal is to produce PWM stack line voltages that are in normal equivalent to reference stack line

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

voltages [17]. Three-stage voltages infused by Fuzzy Logic Controlled Sinusoidal heartbeat width-tweak based miniaturized scale framework inverter and subsystem currents are shown in fig. 9. It can be seen that with proposed outline, smooth waveforms prompt power thick framework operation as wanted. FFT investigation of yield waveforms to check THD demonstrates that proposed technique is very compelling in consonant alleviation and yields smooth and power thick DG framework operation. Additionally, in correlation with beforehand reported results for this issue, 2.13% THD in network associated, approves the handiness of proposed strategy.

B. Hybrid PI & Fuzzy controller - SinusoidalPulseWidthModulationbasedMicro-gridInverter.

The Aim of the hybrid controller is to Combine and utilize the advantages of the PI and fuzzy logic controllers to provide a controller that produce better response than the individual PI or the fuzzy logic controller. Both the PI and fuzzy controller are reasonably good tracking for steady-state or slowly varying operating conditions. Two major differences between the tracking ability of the conventional PI controller and the fuzzy logic controller. But when there is a step change in any of the operating conditions, such as may occur in the set point or load, the PI controller tries to exhibit some overshoot or oscillations. The fuzzy controller reduces both the overshoot and extent of oscillations under the same operating conditions. Even though the fuzzy controller has a slower response by itself, it reduces both the overshoot and extent of oscillations under the same operating conditions. The desire is that, by combining both the controllers can get the quick response of the PI controller while eliminating the overshoot possibly associated with it.

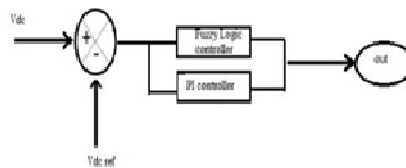


Fig.10.Subsystemmodel for Fuzzy PI Controller

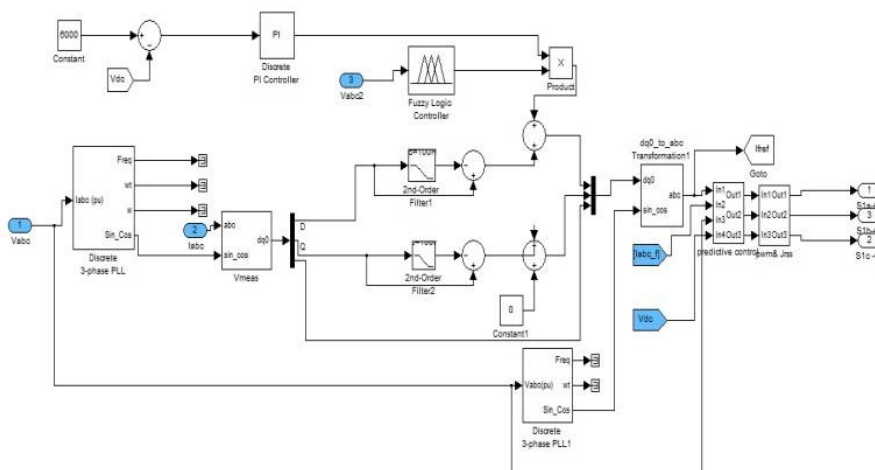


Fig.11. Simulation Subsystemmodel for Hybrid Fuzzy-PI Controller



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

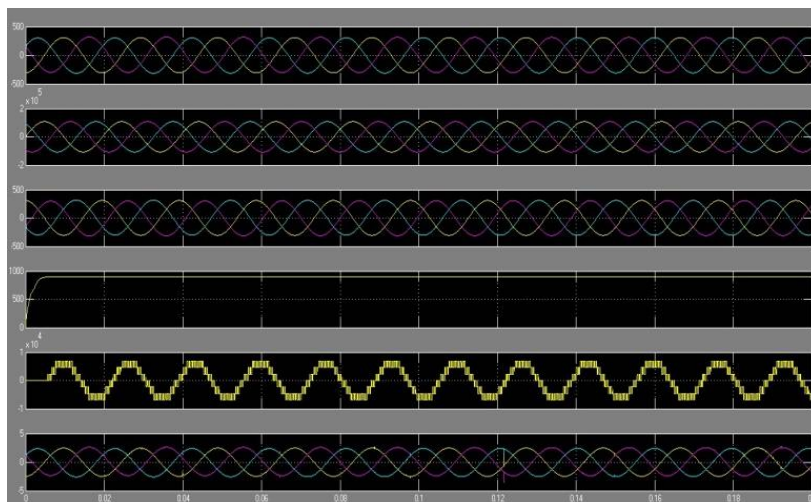


Fig. 12. Subsystem voltages and currents with Hybrid-SPWM based micro-grid inverter

IV. CONCLUSIONS

The control of a DG framework has been enhanced with proficiency, high unwavering quality and power thickness and less multifaceted nature. A consistent and adaptable ongoing arrangement has been proposed to deal with key issues identified with power quality. Parametric results highlight the viability and approval of the approach in which framework level power quality has been progressed. The fundamental commitment of this paper is to total up various methodologies proposed to deal with power quality issues in conveyed era systems and to give an examination between progressive methodologies utilizing different reproductions for consolidated framework.

Table 1. Simulation parameters for SPWM based micro-grid inverter

DC-Link Voltage	V _{dc} =800V
Fundamental Frequency	f=50Hz
Switching Frequency	f _s =1MHz
Sampling Time	T _z =10 ⁻⁶ sec
Modulation Index	a=0.85
Cut-off Frequency	f _o =500Hz

Table 2. THD Comparison for different control strategies

S.No	Control Strategy	%THD
1	Without Filter	27.6
2	PI Control	3.10
3	Fuzzy Control	2.13
4	Hybrid(Fuzzy-PI) Control	1.69



ISSN (Print) : 2320 – 3765
ISSN (Online): 2278 – 8875

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(A High Impact Factor, Monthly, Peer Reviewed Journal)

Website: www.ijareeie.com

Vol. 7, Issue 4, April 2018

REFERENCES

- [1] Savaghebi, M. Jalilian, A., "A new control strategy for distributed generation interface converter to compensate micro-grid harmonics", *International Symposium on Power Electronics, Electrical Drives, Automation and Motion*, 2010.
- [2] Savaghebi, M. Jalilian, A. Vasquez, J. C. Guerrero, J. M.; Lee, T. "Voltage harmonic compensation of a micro-grid operating in islanded and grid-connected modes", *Iranian Conference on Electrical Engineering*, 2011.
- [3] Savaghebi, M. Jalilian, A. Vasquez, J. C. Guerrero, J. M. "Selective compensation of voltage harmonics in islanded micro-grid", *Power Electronics, Drive Systems and Technologies Conference*, 2011.
- [4] Zhou Niancheng, Chi Yuan, Wang Qianggang; "Control strategies for microgrid power quality enhancement with back-to-back converters connected to a distribution network". *15th International Conference on Harmonics and Quality of Power*, 2012.
- [5] Dehghani, M. T. Vahedi, A. Savaghebi, M. Guerrero, J. M. "Voltage quality improvement in islanded microgrid supplying non-linear loads", *Power Electronics and Drive Systems Technology*, 2012.
- [6] Yongqin GU, Peiqiang LI, Yuan PAN, Hui OUYANG, Dong HAN, Yuanzhao HAO, "Development of microgrid coordination and control overview", *IEEE PES Innovative Smart Grid Technologies, Asia*, 2012
- [7] Piagi P, Lasseter R. H. "Autonomous Control of microgrids", *IEEE Power Engineering Society General Meeting*, pp.1-8, June. 2006.
- [8] Savaghebi, M. Jalilian, A. Vasquez, J. C. Guerrero, J. M., "Selective compensation of voltage harmonics in islanded micro-grid", *IEEE Power Electronics, Drive Systems and Technologies Conference*, 2011.
- [9] Shahid, A.; Azhar, H.; A Modular Control Design for Optimum Harmonic Compensation in Micro-grids considering Active and Reactive Power Sharing, *16th IEEE International Conference on Harmonics and Quality of Power*, 2014.
- [10] Shahid, Ahsan, "Modeling and control of distributed generation based micro-grids for power quality studies" M.S. dissertation, *Department of Electrical and Computer Engineering, Univ. Illinois, Chicago*, 2014.
- [11] A. Shahid, "Modeling and control of distributed generation based micro-grids", *LAP Lambert Academic Publishing, Germany*, 2015, pp. 19-22.
- [12] Shahid, A. "A cyber-physical approach for stochastic hybrid control and safety verification of smart grids", *IEEE PES Innovative Smart Grid Technologies, Asia* 2014.
- [13] Dong, Tuo; Li, Linchuan; Ma Zhengbo, "A combined system of APF and SVC for power quality improvement in microgrid", *IEEE Power Engineering and Automation Conference*, 2012.
- [14] Ahsan Shahid, *Student Member IEEE*, Hasan Azhar, "A Modular Control Design for Optimum Harmonic Compensation in Micro-grids considering Active and Reactive Power Sharing", *IEEE*, 2014.
- [15] N. Saida Naik, J. Bhavani; "Grid and Islanded Operation of a Distribution Generation Inverters in a Microgrid", *International Electrical Engineering Journal (IEEJ)*, Vol. 5, No. 10, P.P 1553-1558, 2014.